


MEDIUM VIBRATION TREATMENT

The following is optional post factory treatment for the figure 2000B knife gate valve in medium vibration applications. Medium vibration is defined as oscillation ranging from non-visible to 1/16" transverse pipeline movement. Every effort should be made to reduce vibration in the piping system, as this treatment makes valve stop adjustments more difficult.

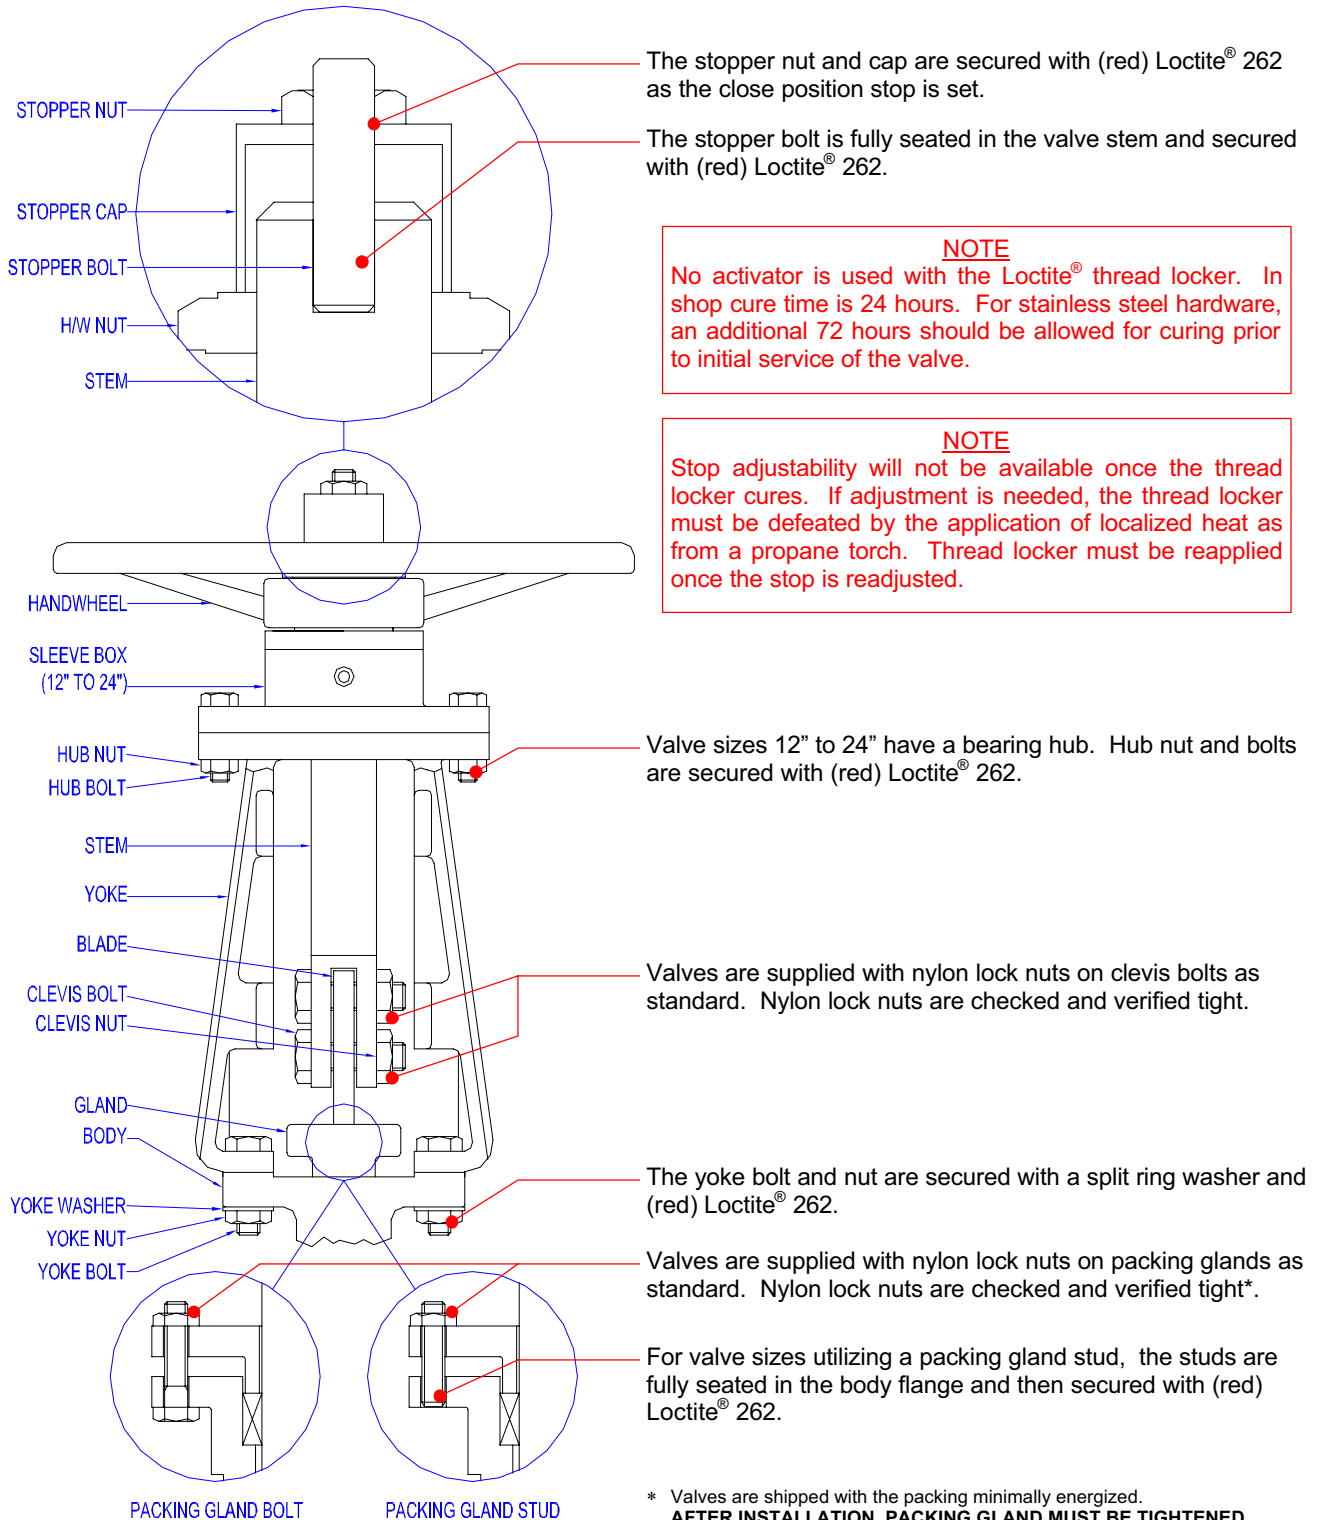

HIGH VIBRATION TREATMENT

The following is optional post factory treatment for the figure 2000B knife gate valve in high vibration applications. High vibration is defined as oscillation ranging from 1/16" to 1/8" transverse pipeline movement. Every effort should be made to reduce vibration in the piping system, as this treatment makes valve stop adjustments more difficult.

